


REF: 6000

Depending on local conditions conduit (metal or plastic) with inspection elbows to be run as follows:


From	Conduit or Cable	To
(A) Electrical Riser	<u>20mm</u> CAT5E	Fixed handset in lobby of flat.

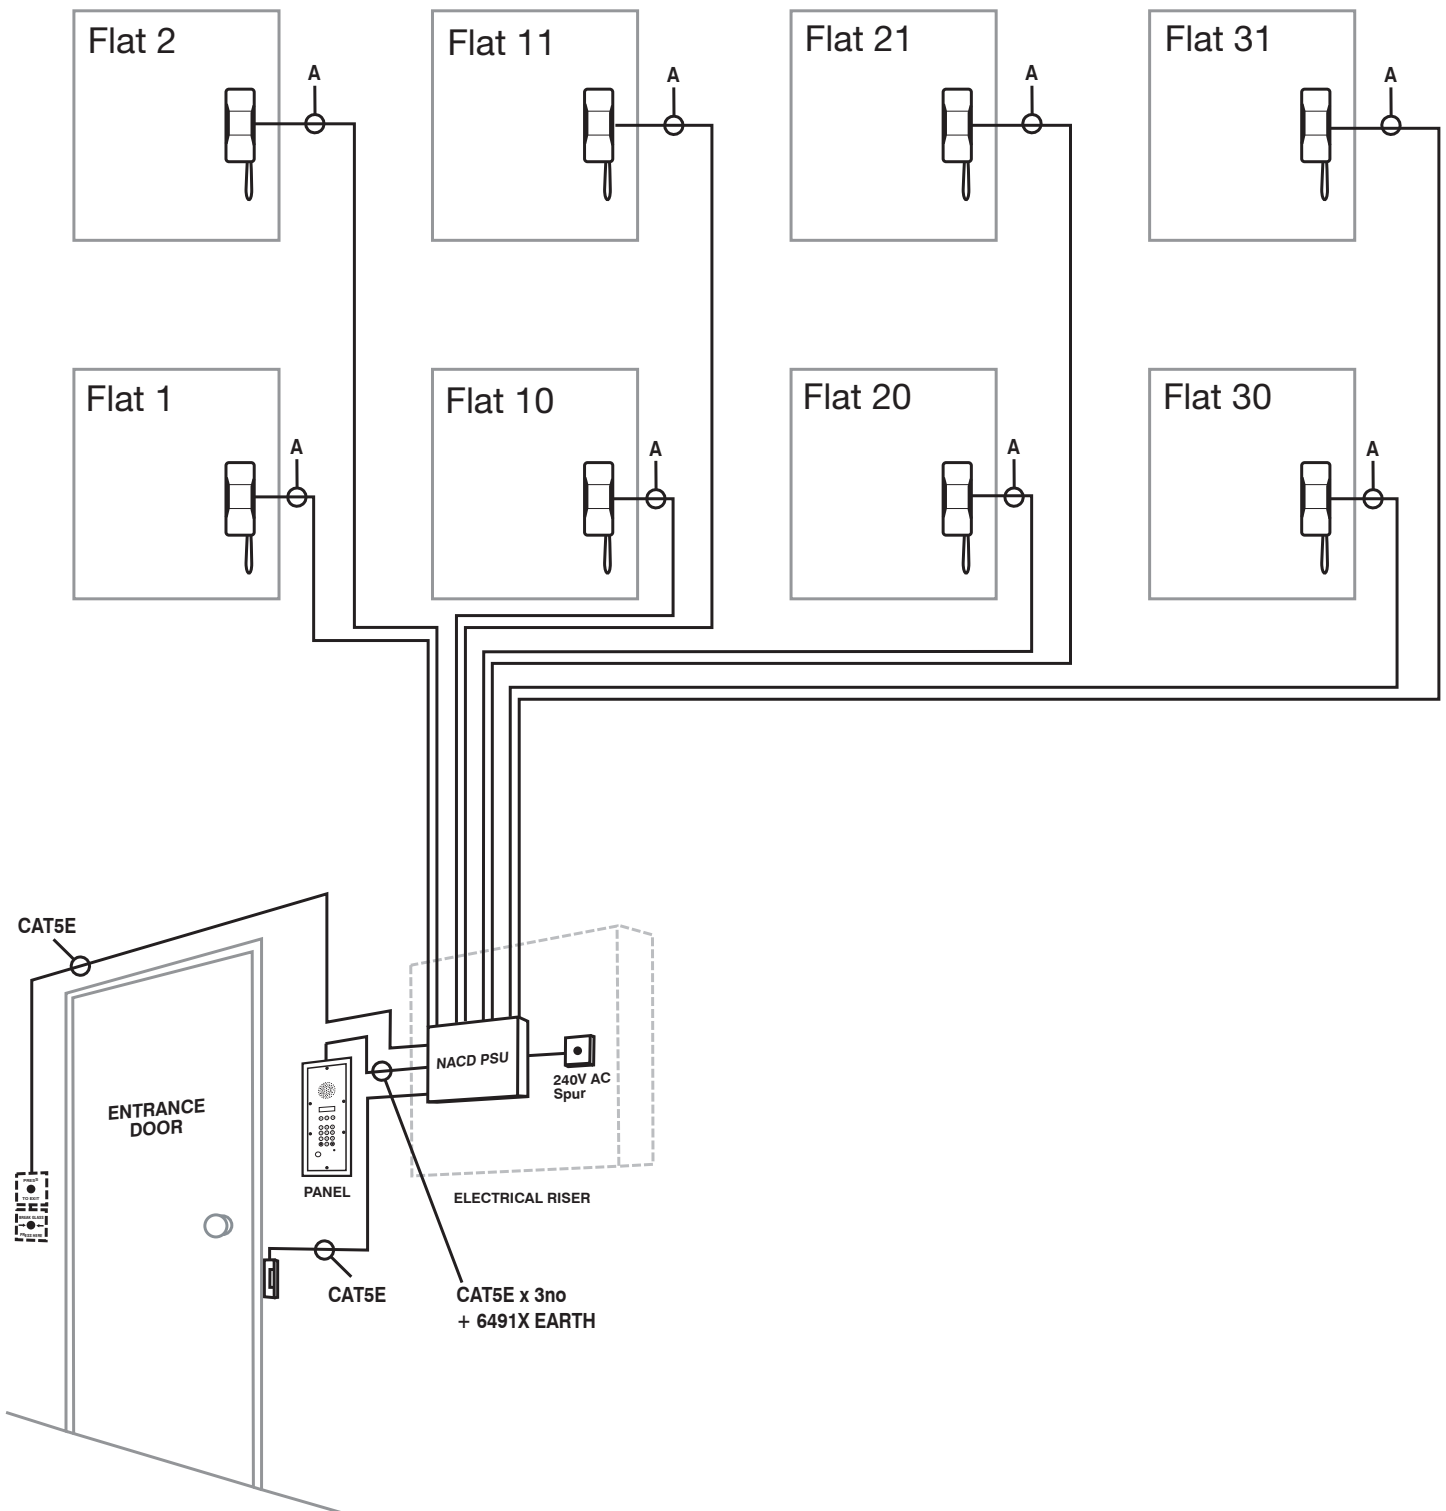

REF: 6001

Depending on local conditions conduit (metal or plastic) with inspection elbows to be run as follows:

From	Conduit or Cable	Cable	To
(A) Electrical Riser	<u>20mm</u>	CAT5E + RG59U Coaxial	Fixed video monitor/handset in lobby of flat.

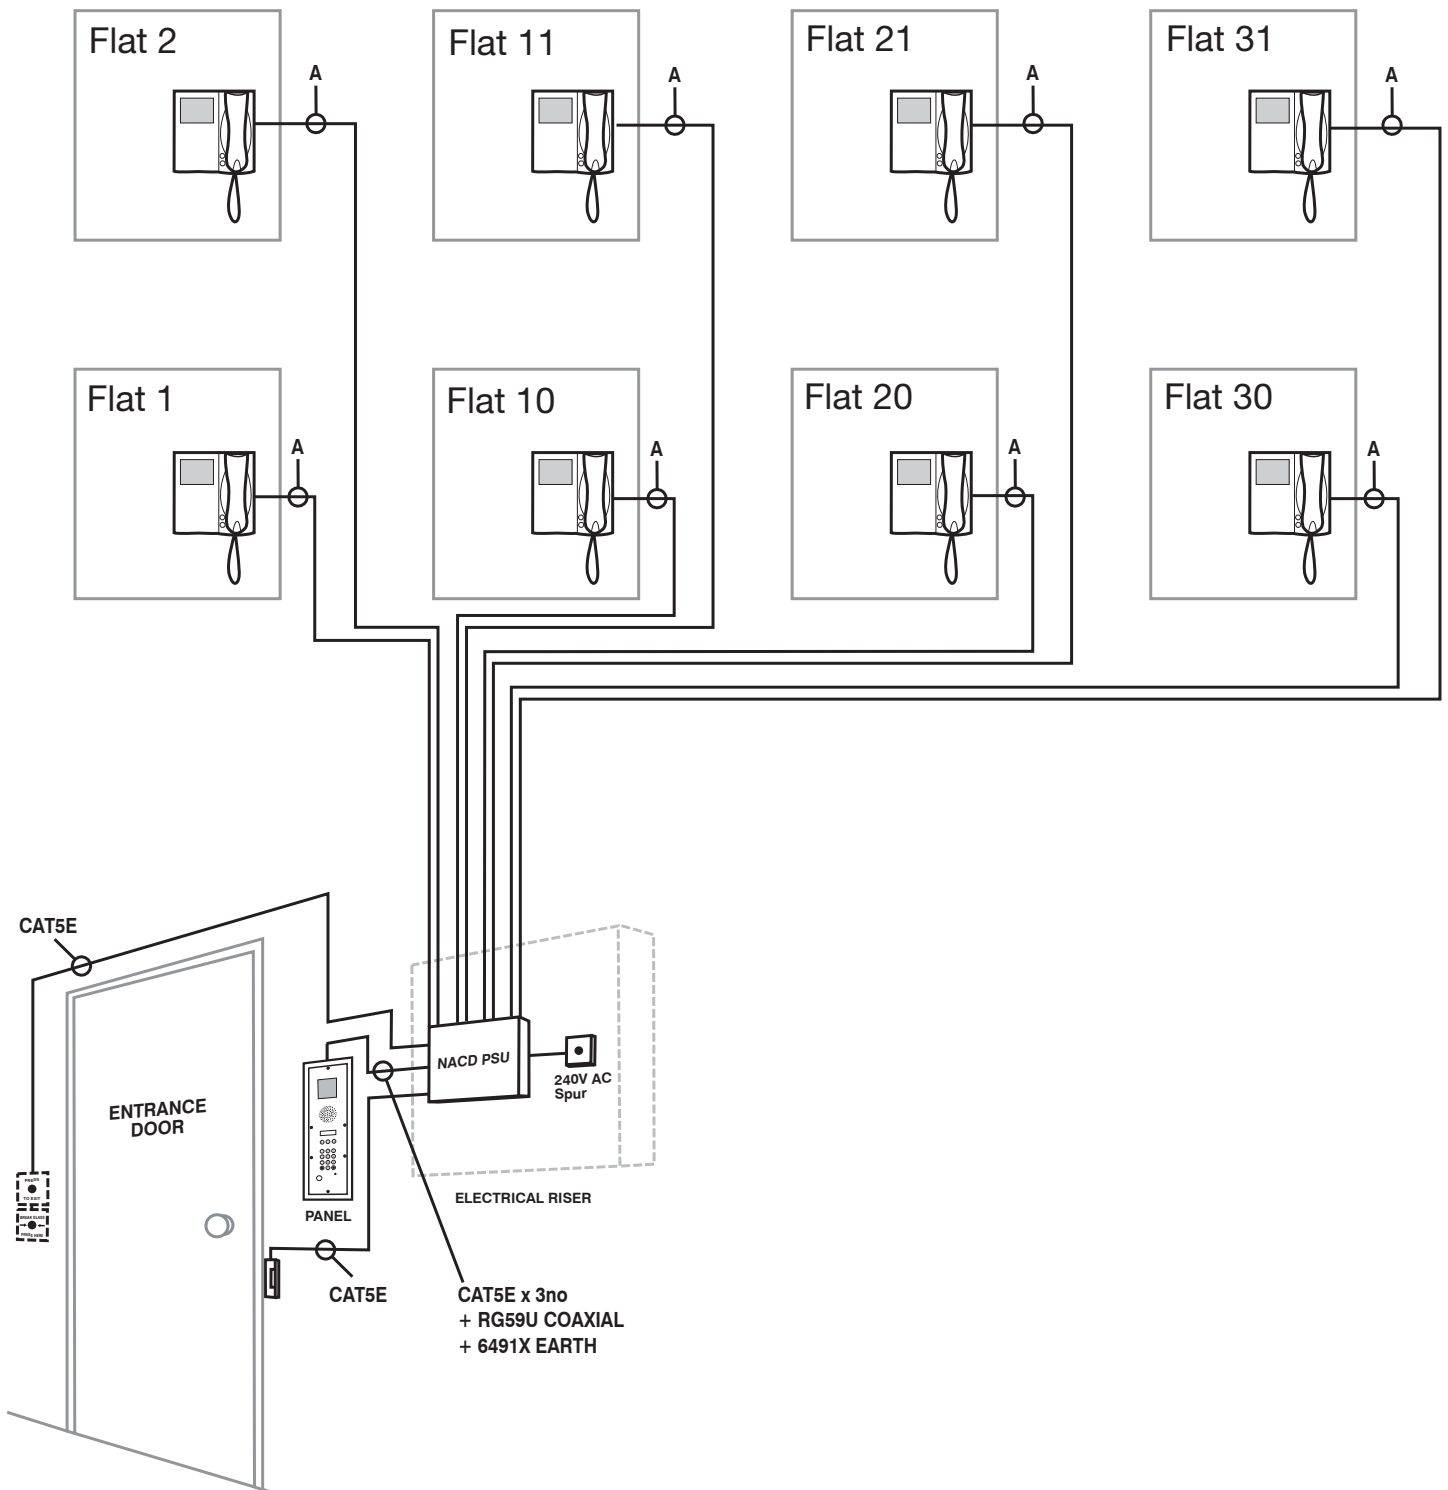

REF: 6002

Depending on local conditions conduit (metal or plastic) with inspection elbows to be run as follows:

From	Conduit or	Cable	To
(A) Electrical Riser	<u>20mm</u>	CAT5E + 6491X Earth	Proximity reader.
(B) Electrical Riser	<u>30mm</u>	CAT5E	Electric lock.
(C) Electrical Riser	<u>20mm</u>	CAT5E	Exit button / Emergency Breakglass

