



EM24EX-V3

To comply with both BS EN 60839-11-2 and the NSI NCP 109.3 Code of Practice for Illumination & Sound Indication.

Pressing the Emergency button momentarily:

Green light illuminates for the preset duration the electrical locking is released.



Alarm buzzer sounds for the preset duration the electrical locking is released.



SELF-RESETTING EMERGENCY EXIT SYSTEM

Designed to replace an EN54-11 type A manual call point in order to release fail safe electric release and fail safe electro-magnetic locking devices on access-controlled doors using indirect activation (BS 7273-4 category C) but substitutes a manual mechanical reset with a timed automatic reset. BS EN 13637: 2015 "Electrically controlled exit systems for use on escape routes" establishes that escape doors can be operated electronically.

Secured by Design



Official Police Security Initiative

SBD, New Homes 2014 (and ONWARDS)

"24.11 Break glass emergency door exit release... on communal external doors that give access into the building... not permitted due to constant abuse."

SECURITY RISK



EM24EX-V3 (FAIL SAFE TIMER RELAY) SELF-RESETTING EMERGENCY EXIT SYSTEM

1

For 12VDC fail-safe locking applications only.

PRESS & HOLD of the Emergency button also cuts power to the EM24EX (Fail Safe Timer Relay) so both its lock relays fail (they need power to be operational) thereby **mechanically (physically) breaking** the fail safe lock power circuits so electrical locking released.

To comply with both BS EN 60839-11-2 and the NSI NCP 109.3 Code of Practice for Illumination & Sound Indication.

Pressing the Emergency button momentarily:

Green light illuminates for the preset duration the electrical locking is released.

Alarm buzzer sounds for the preset duration the electrical locking is released.



AUTOMATICALLY SELF-RESETS



PRESSING THE EMERGENCY BUTTON MOMENTARILY (Press & Release) acts as a power OFF / ON to the EM24EX (Fail Safe Timer Relay) which activates the hold unlocked release feature of the electrical locking for the preset duration period.

PRESS & HOLD of the Emergency button also **mechanically (physically) breaks** the lock power circuit so electrical fail safe locking released.

EMERGENCY BUTTON



Building Regulations Part M (Access), Clause 2.17C.

"Doors must be openable.....using a CLOSED/CLENCHED fist..."

The Emergency button must be raised proud of the mounting surface to comply.



BS-EN-11 provides examples of symbols on emergency "call-points", to simplify understanding of usage for all.



For 12VDC fail-safe locking applications only.

SECURED BY DESIGN, NEW HOMES 2014 (ONWARDS):

24.11 Break glass emergency door exit release devices (often green in colour) on communal external doors that give access into the building are **not permitted due to constant abuse**. Instead, **vandal resistant stainless steel** self-resetting emergency exit systems are to be installed. **The installation and system type must be in full compliance and achieve final 'sign-off' by local Building Control.**

SECURITY RISK DOES NOT AUTOMATICALLY RESET



PLASTIC SO EASILY
VANDALISED OR
ANTI-SOCIAL ACTIVATION
= DOOR REMAINS UNLOCKED !

SBD, New Homes 2014 (and ONWARDS)

"24.11 Break glass emergency door exit release... on communal external doors that give access into the building... not permitted due to constant abuse."

EM24EX-V3 AUTOMATICALLY SELF-RESETTING



MUST BE STAINLESS STEEL
VANDAL RESISTANT

To comply with
both BS EN
60839-11-2 and
the NSI NCP 109.3
Code of Practice
for Illumination &
Sound Indication.

Pressing the
Emergency button
momentarily:

Green light
illuminates for the
preset duration the
electrical locking is
released.

Alarm buzzer
sounds for the
preset duration the
electrical locking is
released.



Designed to replace an EN54-11 type A manual call point in order to release fail safe electric release and fail safe electro-magnetic locking devices on access-controlled doors using indirect activation (BS 7273-4 category C) but substitutes a manual mechanical reset with a timed automatic reset. BS EN 13637: 2015 "Electrically controlled exit systems for use on escape routes" establishes that escape doors can be operated electronically.



MAX 1 METRE DISTANCE AT MAX 1 METRE
HEIGHT AFFL FROM DOOR PULL/PUSH HANDLE.

For 12VDC fail-safe locking applications only.

IMPORTANT:

The specification (based on application and security level requirements) and the installation of Door Release and Emergency Exit devices on communal doors must be in full compliance with the relevant Building Regulations, achieve final 'sign-off' by local Building Control / Approved Inspector (as applicable), and must comply fully with any fire evacuation policies.

A detailed commissioning sheet is required for each door and it must be signed and clearly identify the installer. If you do not receive a satisfactory commissioning sign-off, do not accept the installation.

This is a safety device to guarantee escape in the event of an emergency.



EM24EX-V3 + 1F
FLUSH

Flange: 160 mmH x 145 mmW
Backbox: 130 mmH x 113 mmW x 50 mmD



EM24EX-V3 + 1S
SURFACE

120 mmH x 104 mmW x 50 mmD

ALL EXTERNALLY RATED

Designed to replace an EN54-11 type A manual call point in order to release fail safe electric release and fail safe electro-magnetic locking devices on access-controlled doors using indirect activation (BS 7273-4 category C) but substitutes a manual mechanical reset with a timed automatic reset. BS EN 13637: 2015 "Electrically controlled exit systems for use on escape routes" establishes that escape doors can be operated electronically.



**MAX 1 METRE DISTANCE AT MAX 1 METRE
HEIGHT AFFL FROM DOOR PULL/PUSH HANDLE.**

EM24EX-V3 (FAIL SAFE TIMER RELAY) SELF-RESETTING EMERGENCY EXIT SYSTEM

4

For 12VDC fail-safe locking applications.

SAFETY FEATURE nos 1 and 2.

When the bottom emergency exit button is pressed it also simultaneously removes power from the EM24EX-V3.

Power returns immediately the bottom button is released.

This split second power off then back on triggers the EM24EX-V3 "hold-open" operation which breaks both lock power circuits for a preset period of 3 minutes which means that the door is unlocked for 3 minutes.

Pressing the bottom emergency button removes power from the EM24EX-V3. So whilst the bottom button is held pressed in no power gets to the EM24EX-V3 fail safe powered relay so both its lock relays fail (they need power to be operational) thus breaking the locking power circuits so no power gets to the fail safe lock. The door is unlocked.

The 3 minute "hold open" AUTO-RESETTING latching function of the EM24EX-V3 is an additional feature that becomes irrelevant should the EM24EX-V3 (for any reason) malfunction = fail safe lock fails = the door is unlocked permanently, not just for 3 minutes, engineer call-out required to fix so that the door can be relocked.

SAFETY FEATURE no 3.

When the bottom emergency exit button is pressed it also mechanically breaks the lock power circuit. No power gets to the fail safe lock whilst the button is held pressed in = Door is unlocked.

SAFETY FEATURE nos 4 and 5.

If the Power Supply Unit (PSU) servicing the EM24EX-V3 fails, no power gets to the EM24EX-V3 fail safe powered relay so both its lock relays fail (they need power to be operational) thus breaking the locking power circuits so no power gets to the fail safe lock. The door is unlocked.

SAFETY FEATURE nos 6 & 7.

If the Power Supply Unit (PSU) servicing the fail safe lock fails, no power gets to the lock. The door is unlocked.

SAFETY FEATURE nos 8 & 9.

If the EM24EX-V3 Fail Safe 12VDC Powered Timer Relay fails for any reason both lock relays fail breaking the locking power circuits so no power gets to the fail safe lock. The door is unlocked.

IMPORTANT

If any cable core from either of the Exit Buttons to the EM24EX-V3 relay, or from the Power Supply to the EM24EX-V3 relay, or on the EM24EX-V3 relay itself breaks or detaches – the electric fail safe lock will immediately fail = The door is unlocked.

The EM24EX-V3 relay does not need control resets but as with all life safety products it is a requirement to include it in the maintenance schedule.



MAX 1 METRE DISTANCE AT MAX 1 METRE
HEIGHT AFFL FROM DOOR PULL/PUSH HANDLE.

From: Louis Taylor [mailto:LoTaylor@nhbc.co.uk]
Sent: 30 June 2014 16:51
To: Richard Collis
Subject: RE: urgent question , need guidanceCycle stores locking.

Dear Richard,

Double pole (DP) Exit Button only is NOT permitted

Doors that require you to hold down a button whilst pushing a door would not be permitted as it's a requirement of both Part B (Fire Safety) and Part M (access – for the disabled) that the door is openable without having to manipulate more than one mechanism, using a clenched fist. This is so that persons with limitations with their hands/limbs only have to use one limb to open. If you thus need two hands to operate such devices they would not be permitted and should not thus be used.

If you've any other queries regarding the above please feel free to get in touch.

Kind regards

Louis

The Exit Button needs to be of sufficient diameter, or suitable shape to be depressed and released using a clenched fist.

Louis Taylor MRICS BEng(Hons) MSc MCABE C.Build E

Commercial Building Control Surveyor

Direct line: 0114 2864289

email: lotaylor@nhbc.co.uk

NHBC | NHBC House | Davy Avenue | Knowlhill | Milton Keynes | MK5 8FP

Tel: 0844 633 1000 | Fax 0844 633 0022 | www.nhbc.co.uk



EMERGENCY BUTTON

Building Regulations Part M (Access), Clause 2.17C.

“Doors must be openable... using a CLOSED/CLENCHED fist...”

The Emergency button must be raised proud of the mounting surface to comply.



THE DISABILITIES THAT MUST BE ADDRESSED ARE:



Hearing problems



Visual problems



Wheelchair users



Elderly, mobility problems



Arthritic

Equality Act 2010 compliance

Equality Act 2010 compliance means that the service provided must not discriminate against people with disabilities. The objective of the ACT is to make sure that disabled persons can access the services that have been provided as easily as able bodied persons.

It is, therefore, **reasonable** that a visitor door entry system must not be audio only – if it is to comply with the **Equality Act** because **a resident with a hearing disability** would clearly be disadvantaged and **would benefit from being able to view visual images**.

Visuals from a visitor door entry system must be provided to flats.

A resident with a visual, hearing or mobility disability needs to be able to view, hear, speak and open the door to the visitor as easily as an able bodied person.

It is **reasonable** to expect that the visitor door entry panel, resident access control proximity readers / keypads, exit buttons, emergency exit devices are designed with **reasonable features** to make actual usage as easy as possible for persons with disabilities. For example; buttons should be large, tactile, braille embossed, raised, illuminated as applicable. There should be bright colour display screens, voice and visual information output messages, visual icons, audible alarms and hearing aid loops.

Fireman switches, trades buttons, programming buttons and cameras are not used by visitors and so have marginal relevance to Equality Act 2010 compliance; for example, the camera providing the visual pictures (services) to residents is not a 'touch' device used by visitors.

The Equality Act 2010, the "ACT", requires public bodies, landlords and other service providers to prevent and address disability discrimination. The Equality Act serves not only to ensure that these various bodies do not discriminate, but there can also be a positive legal requirement on these bodies to make **reasonable changes** to improve services for disabled people.

The Equality Act protects anyone with a **disability**, defined as "a physical or mental impairment that has a substantial and long-term adverse effect on the ability to carry out normal day-to-day activities". Blind, visually impaired, hearing impaired, speech impaired, arthritic and the mobility impaired (physically disabled and elderly) are all protected as **disabled**.

The requirement to make **reasonable changes** applies to landlords and service providers. A service provider is defined in the Equality Act as "a person concerned with the provision of a service to the public or a section of the public (for payment or not)". This is clearly a wide definition and includes all bodies that deal directly with members of the public, including Housing Associations and all other services provided by government departments. A builder would be a service provider to the extent that they provide services to the public. This duty requires service providers to take positive steps, and not simply to avoid discrimination. **Reasonable changes are required wherever disabled people would be at a substantial disadvantage compared with non-disabled people. A substantial disadvantage is defined as a "disadvantage which is more than minor or trivial"**.

Importantly, landlords and service providers are now obliged to think ahead and take steps to address barriers that impede disabled people and not wait until a disabled person experiences difficulties using a service.

Furthermore, the Equality Act also imposes a duty on public bodies (under section 149) to "advance equality of opportunity between persons who share a relevant protected characteristic and persons who do not share it". The definition of public body includes councils, hospitals, police across the UK. Therefore, failure by a public body to approve of systems that can assist persons with disabilities may be in breach of disability discrimination legislation, and failure by a public body to use systems that can assist persons with disabilities may be in breach of disability discrimination legislation.

The following may be considered as examples of disability discrimination:

1. Failure by a public body, landlord or other service provider to approve or implement visitor door entry systems and/or resident access control systems which would assist disabled persons.
2. Approval (or failure to adjust) by a public body, landlord or other service provider of a visitor door entry system and/or resident access control system which places disabled people at a disadvantage which is more than minor or trivial.

THE DISABILITIES THAT MUST BE ADDRESSED ARE:



Hearing problems



Visual problems



Wheelchair users



Elderly, mobility problems



Arthritic

Always think LIFE SAFETY!

What if it was my child or elderly parent needing to escape in an emergency?

And what about these people?

Have **reasonable** features been provided to make it easy for them to use the Egress, Access and Visitor Entry?

A person with:

severe arthritis
cerebral palsy
one hand, one arm or one leg
a broken arm or leg in plaster
coordination problems
no hands

A person:

who has collapsed because of the smoke
who is panicked
using a walking stick for balance
in a wheelchair
visually impaired
hearing impaired

A mother carrying a baby

An elderly frail person

A child

“the operation of switches... does not require the simultaneous use of both hands”



It is **NOT permitted** to have a system where the only emergency exiting procedure requires that the person **needs to hold in a button and at the same time pull/push the door** because many people will not be capable of doing this.

The Emergency Exit Button must have a latching UNLOCK facility so that when pressed momentarily which means - in the normal way so pressed and immediately released - the electric locking system on **the door latches unlocked for a minimum period of 3 minutes**. This means that (1) the person escaping does not need to operate two things at once (2) **a person who has collapsed due to smoke and crawled up to the door is not faced with a locked door.**

Must be fitted within 1 metre maximum distance of the door exit pull/push handle at a maximum height of 1 metre AFFL.

“Doors must be openable without having to manipulate more than one mechanism, using a **CLOSED/CLENCHED fist...”**




Wheelchair users



Elderly, mobility problems



Arthritic

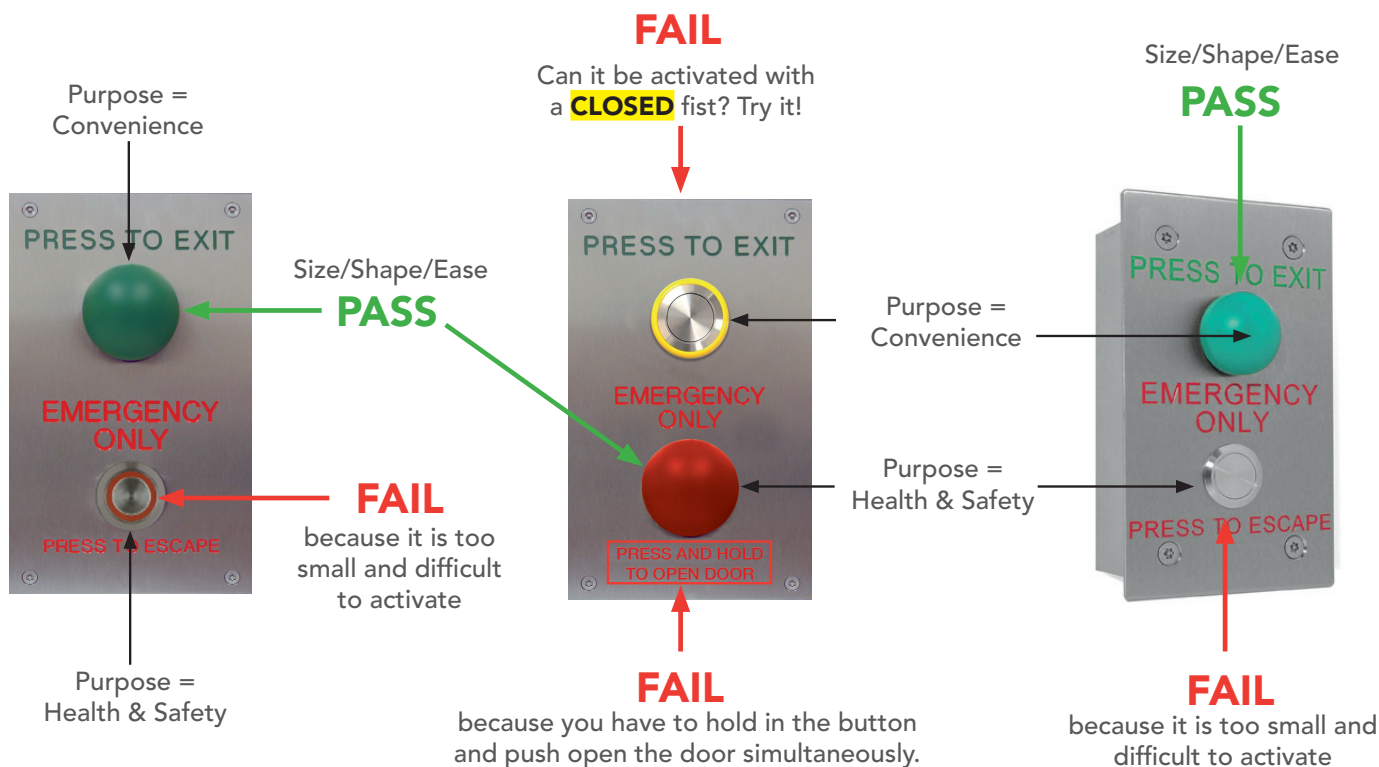


EMERGENCY BUTTON



Building Regulations Part M (Access), Clause 2.17C.


“Doors must be openable.....using a CLOSED/CLENCHED fist...”

The Emergency button must be raised proud of the mounting surface to comply.

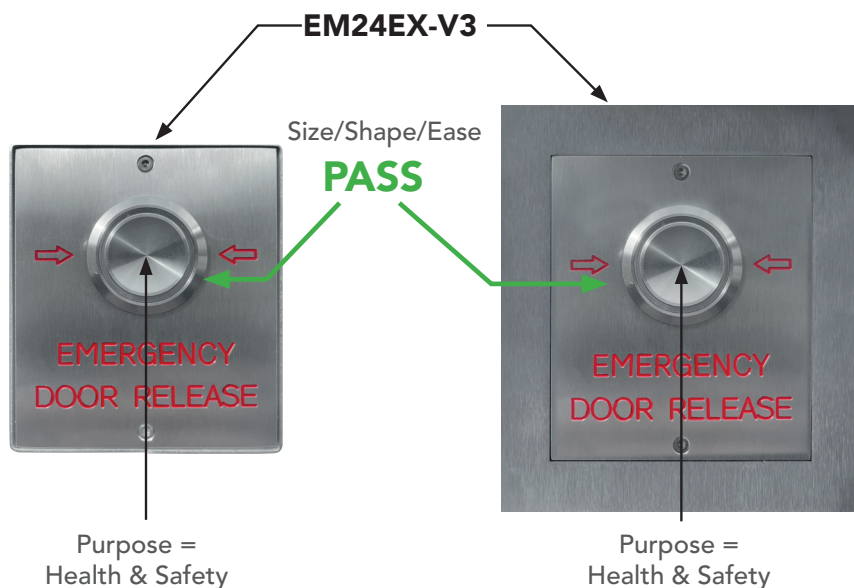

IMPORTANT SAFETY WARNING

The mechanical Push to Break (PTB) safety features on the exit button(s) **ONLY WORK** if the door can be pulled / pushed open whilst holding the button pressed in.

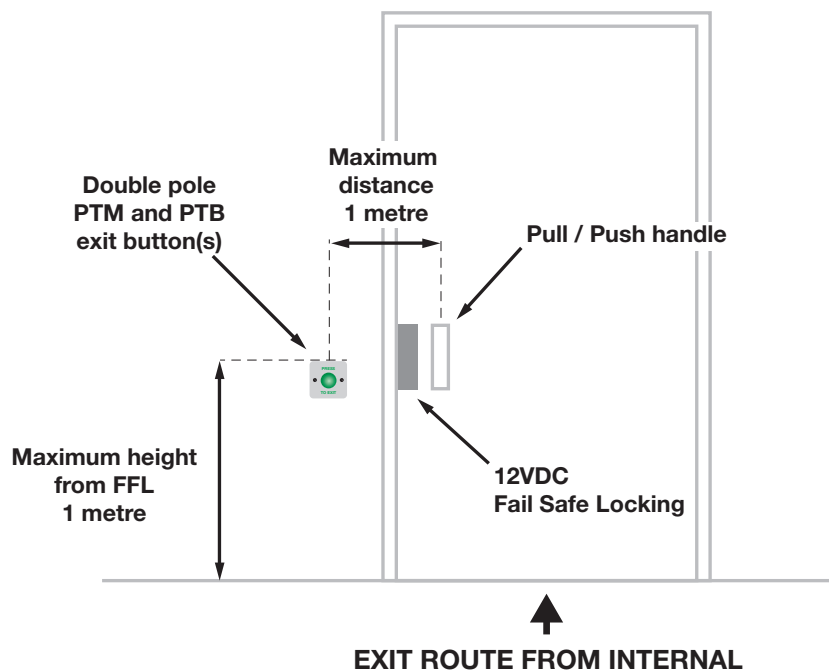


**THINK SAFETY,
THINK FIRE, THINK
EMERGENCY EXIT.
LIVES DEPEND
ON A CORRECT
INSTALLATION.**

**REPORT
NON-COMPLIANT
INSTALLATIONS
IMMEDIATELY.
LIVES DEPEND
ON IT!**

HEALTH & SAFETY WARNING

NOT SAFE !

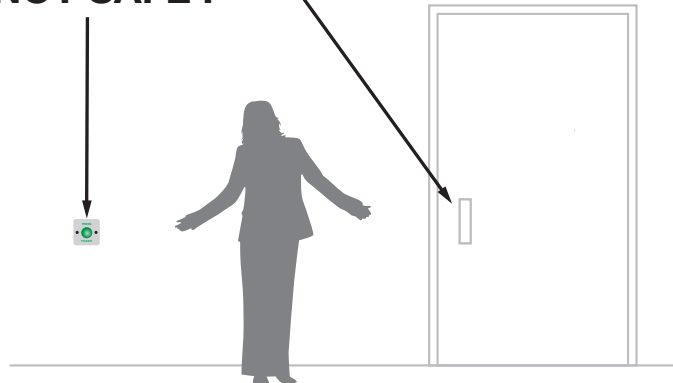

If a person cannot reach the exit button
AND the door handle at the same time,
the safety PTB poles of the button are
USELESS. The installation is unsafe and dangerous.

**ALWAYS CHECK THAT WHEN A BUTTON IS PUSHED AND HELD DOWN
THE DOOR STAYS UNLOCKED AND DOES NOT RE-LOCK.**

ALL INSTALLATIONS MUST COMPLY WITH BUILDING CONTROL REGULATIONS.



**MAX 1 METRE DISTANCE AT MAX 1 METRE
HEIGHT AFFL FROM DOOR PULL/PUSH HANDLE.**


CORRECT POSITIONING OF EXIT BUTTON(S) IS VITAL

The PTB (Push to Break) contacts on the button **mechanically** break the 12VDC Fail Safe lock power circuit but only when the button is pressed in.


The instant the button is released, the 12VDC Fail Safe lock is immediately re-powered and the door immediately locks.

If the person cannot both press the button in and push or pull the door open at the same time, the installation is dangerous.


1A CORRECT

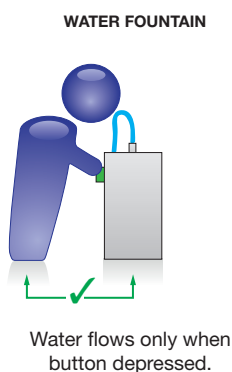


1B FAULTY & DANGEROUS!

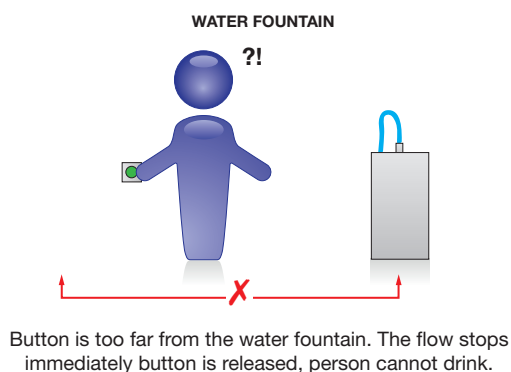

2A CORRECT

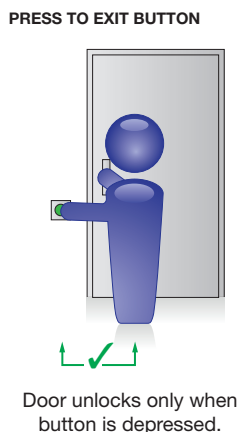

2B FAULTY & DANGEROUS!

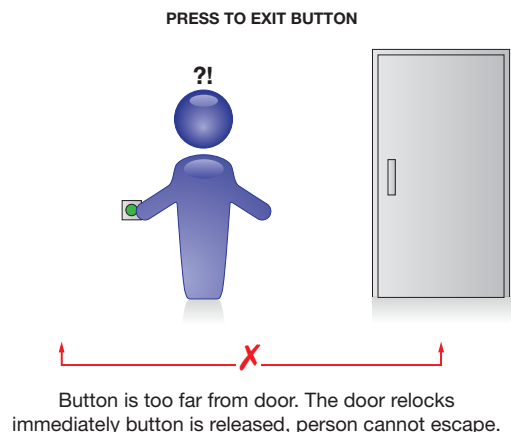

WARNING: Must be fitted within 1 metre maximum distance of the door exit pull/push handle at a maximum height of 1 metre from FFL.

Position carefully so that door does not open OVER the exit button(s).

EM24EX-V3 SELF-RESETTING EMERGENCY EXIT SYSTEM CABLING CONFIGURATION

12

EM24EX-V3 (12VDC POWERED RELAY)

**EM24EX-V3 IS A
FAIL SAFE
DEVICE FOR
SAFETY REASONS.**

HOLD-UNLOCKED TIME DURATION SETTINGS

TM M2 (top) dial

To latch open (hold unlocked) electric locking (change status of locking from locked to unlocked) when Emergency Button is momentarily pressed and released.

Top dial

Set arrow to always point to 10M

Time dial

Set arrow to point as follows to hold unlocked

For 3 mins = 3 Do not go lower than 3 mins

For 5 mins = 5



Letters dial

Set arrow to always point to A

Function dial


Set arrow to always point to 28

Means relays 15-18 & 23/27-24/28 mimic each other.

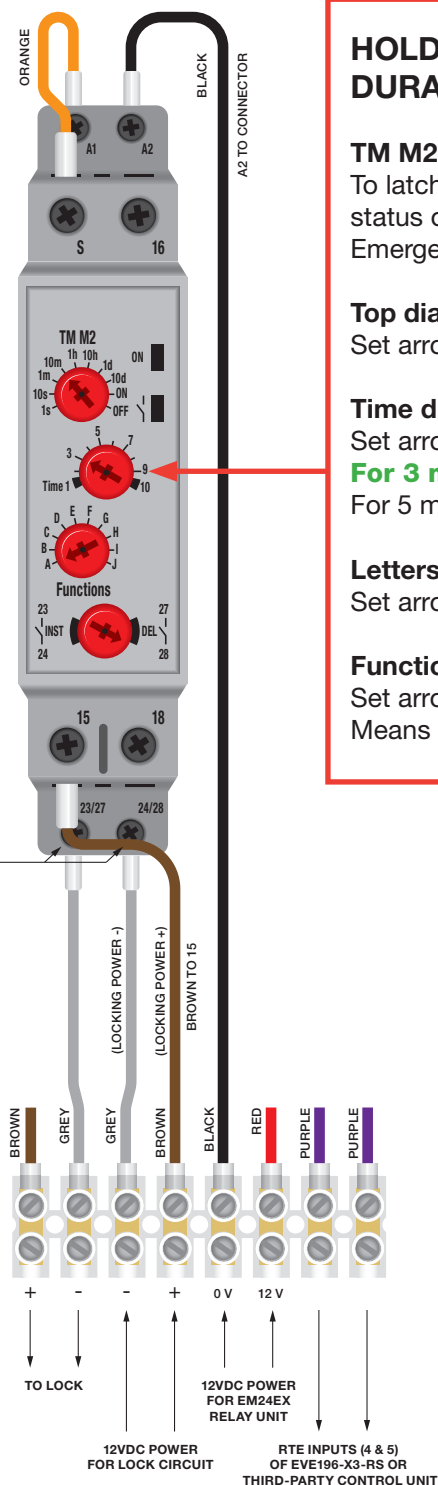


EM24EX-V3 SELF-RESETTING EMERGENCY EXIT SYSTEM CABLING CONFIGURATION

13

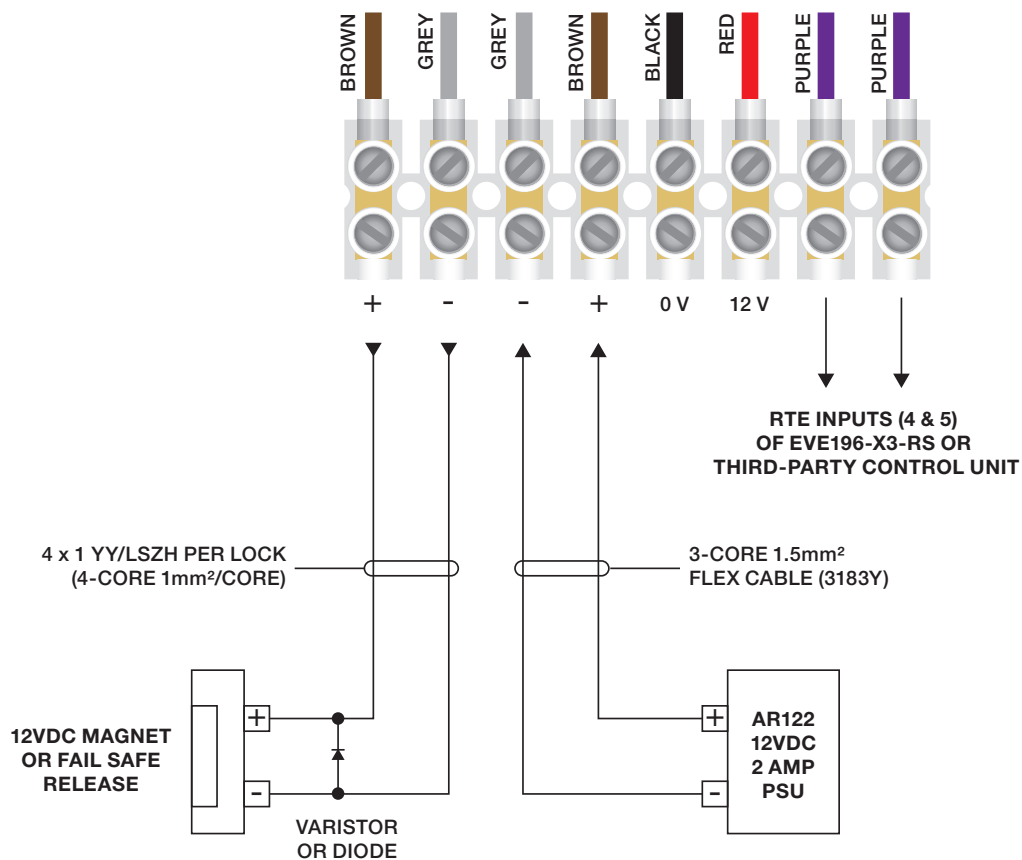


EM24EX-V3 STAINLESS STEEL HOUSING

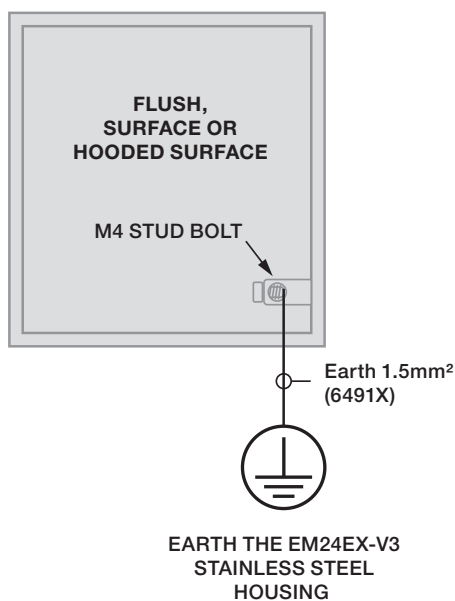


EM24EX SELF-RESETTING EMERGENCY EXIT SYSTEM

EM24EX CABLING SPECIFICATIONS

T N° 070/4 with SBD compliant EM24EX system

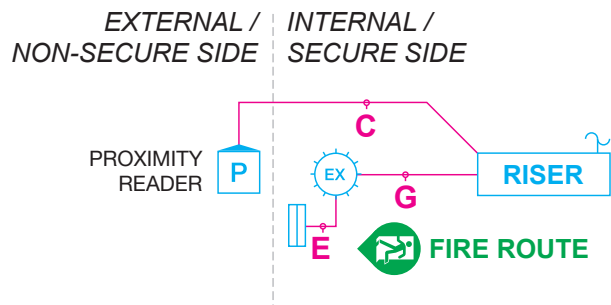

T N° 070/2 with SBD compliant EM24EX system

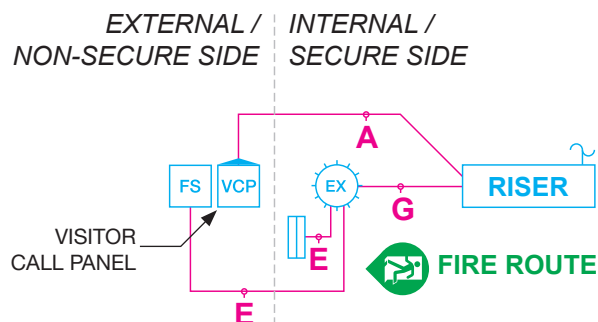


INSTALLATION COMPONENTS

	12VDC fail safe electric release or electro-magnet (as per advice or pre-installed by door supplier for door type, designation and usage profile).	L08
	Fireman switch.	L16
	EM24EX stainless steel normal exit + self-resetting emergency exit system (fitted within 1 metre maximum distance of the relevant door exit pull/push handle at a maximum height of 1 metre from FFL). All locking must be 12VDC fail safe.	L41
	EM24EX-VR stainless steel self-resetting emergency exit system (fitted within 1 metre maximum distance of the relevant door exit pull/push handle at a maximum height of 1 metre from FFL). All locking must be 12VDC fail safe.	L41A

CABLING

- A** Class E (CAT6) U/UTP x 4no
+ Earth 1.5mm² (6491X)
- C** Class E (CAT6) U/UTP
+ Earth 1.5mm² (6491X)
- E** Lock circuit cable ref. 4 x 1 YY/LSZH per lock
(4-core, 1mm²/core)
- G** Lock circuit cable ref. 4 x 1 YY/LSZH per lock
(4-core, 1mm²/core)
+ Class E (CAT6) U/UTP x 1no

LOCKING CIRCUIT CABLE 4 x 1 YY/LSZH (3184B LSZH)

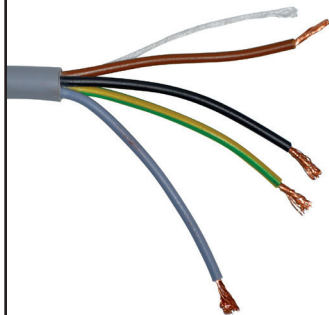

Maximum distance from locking
to power supply location:
50 metres for 1 amp lock
30 metres for 2 amp lock

CABLE REFERENCE:
4 x 1 YY/LSZH

PER LOCK

Fail safe locking relies on the locking receiving the correct voltage and current. Only industry reference 4 x 1 YY/LSZH cabling (or Fire Protected equivalent, if applicable) is to be used. Alarm, data or communications cabling; for example; CAT5E, CW1308 is unacceptable.

Conductors:	Flexible copper, class 5.
Core identification:	4 core: brown, grey, black, green/yellow
Insulation:	LSZH
Sheath/Jacket:	LSZH
Colour:	Grey
Voltage:	300/500V
Operating temperature:	-5°C / + 70°C
Minimum bending radius:	6 x overall diameter
Standards:	BS EN 50525-3-11, EN 61034-2, EN 60332-1-2.

Core size sq.mm	No of cores	Radial thickness of insulation mm	Nominal overall diameter mm	Weight kg/km
1	4	0.6	7.9	99

T: 01322-441165 Product ref: 3184B-Grey Part number: 45574 www.batt.co.uk

The BS 7273-4 standard relates to the actuation of release / locking mechanisms for doors that must release / unlock or open in the event of a fire. This actuation is nearly always a signal/device from the fire alarm system that results in the electric locking mechanism (electric release) unlocking or opening the relevant door(s). This actuation system must bypass any additional access control Exit Buttons (RTE's) that may be in use for normal exiting purposes on, for example, a main communal door.

BS7273-4 specifically addresses fire alarm actuated release / locking systems with **Manual Reset** functionality. If the door is required to also open on activation of the fire alarm system, then the fail safe electric release / locking mechanism must also be directly controlled by a compliant fire alarm device. These types of doors are usually main and rear block entrance doors but also often any normal use communal doors that are on fire-escape routes.

The Type A manual release that is mentioned in BS 7273-4 is required to have a manual reset function. The crucial words here are **Manual Reset** which is usually not suitable for developments with multiple dwellings where misuse and/or deliberate abuse (activation) of green manual release breakglass units leaves the connected door(s) unlocked and the building insecure (access control rendered ineffective) until the green breakglass emergency exit unit is manually reset by an engineer or caretaker.

BS7273-4 does NOT address Automatic Timed Self-Resetting Emergency Exit systems.

The EM24EX range of Automatic Timed Self-Resetting Emergency Exit systems does not fall within the scope of BS 7273-4 for FIRE EXIT ONLY doors controlled by a fire alarm system because the standard is not applicable to emergency exit devices with **Automatic Timed Self-Reset**.

The EM24EX range, therefore, employs an **Automatic Timed Self-Resetting mechanism** which differs from the manual reset approach outlined in BS 7273-4:2015 because it is designed to meet building regulations regarding emergency egress and also the security requirements of Secured by Design in addressing the challenges of misuse associated with traditional manual reset devices.

The EM24EX range of **Automatic Timed Self-Resetting Emergency Exit devices** are designed for doors that are NOT solely fire exit doors but rather general use doors, for example; block entrance and exit doors in co-ordination with building/fire control and Secured by Design Officers. They are designed with an automatic timed self-reset and not a mechanical manual reset to meet the security requirements for Secured by Design certification.

The EM24EX range of **Automatic Timed Self-Resetting Emergency Exit devices** are specifically designed to meet the anti-vandalism and security requirements of Secured by Design 2025 (and earlier) that specifically demands automatic self-reset and NOT manual reset.

Extract from **Secured by Design Residential Guide 2025, Section 34.1** 'Break glass emergency door exit release devices (often green in colour) on communal external doors that provide an important aid to egress in the event of an emergency have proven to be abused rendering some buildings insecure for long periods of time. SBD recommends vandal resistant stainless steel self-resetting emergency exit systems are installed as an alternative. The installation and system type must be in full compliance with the relevant Building Regulations and achieve final 'sign-off' by local Building Control or Approved Inspector.'

It is vital to understand that the EM24EX product (and all emergency exit devices) must be professionally installed to include a documented commissioning test plan, records and PPM schedule in accordance with all relevant building and electrical safety regulations and also to Secured by Design requirements.

The installation must be signed off by the relevant professional body.



+44 (0)1442 211848
estimating@nacd.co.uk

www.nacd.co.uk
f in nacdltd

NACD Limited, 1 Enterprise Way,
Hemel Hempstead, HP2 7YJ

